


BASIC SYSTEM (FRAG HIR or 400)

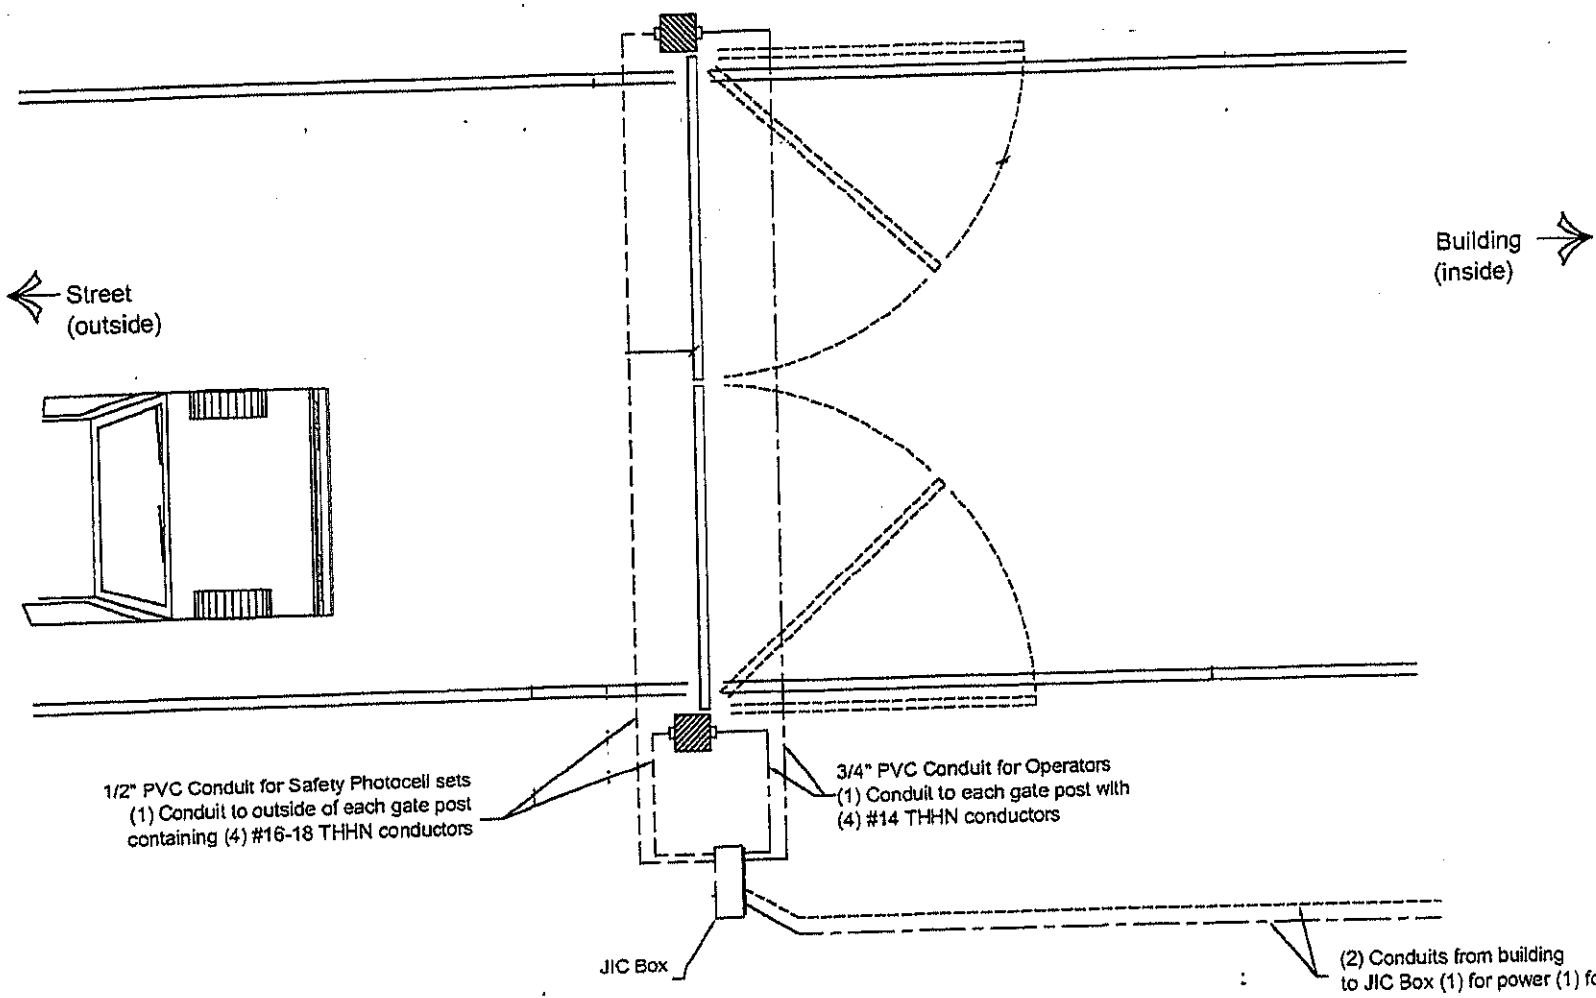

1/2" PVC Conduit for Safety Photocell sets
(1) Conduit to outside of each gate post
containing (4) #16-18 THHN conductors

3/4" PVC Conduit for Operators
(1) Conduit to each gate post with
(4) #14 THHN conductors


JIC Box

(2) Conduits from building
to JIC Box (1) for power (1) for phone

Open Sesame, Inc. Tel: 800-666-4798
70 James Street, Worcester, MA 01603 Fax: 508-752-6824

Date Drawn: 1/18/03	Scale: Not to Scale	Customer: Layout #1 (reverse)
Drawn By: SDD	Project #: XXXXX	Page# _____ of _____

AUTOMATIC SYSTEM (EARG HIR 02 400)

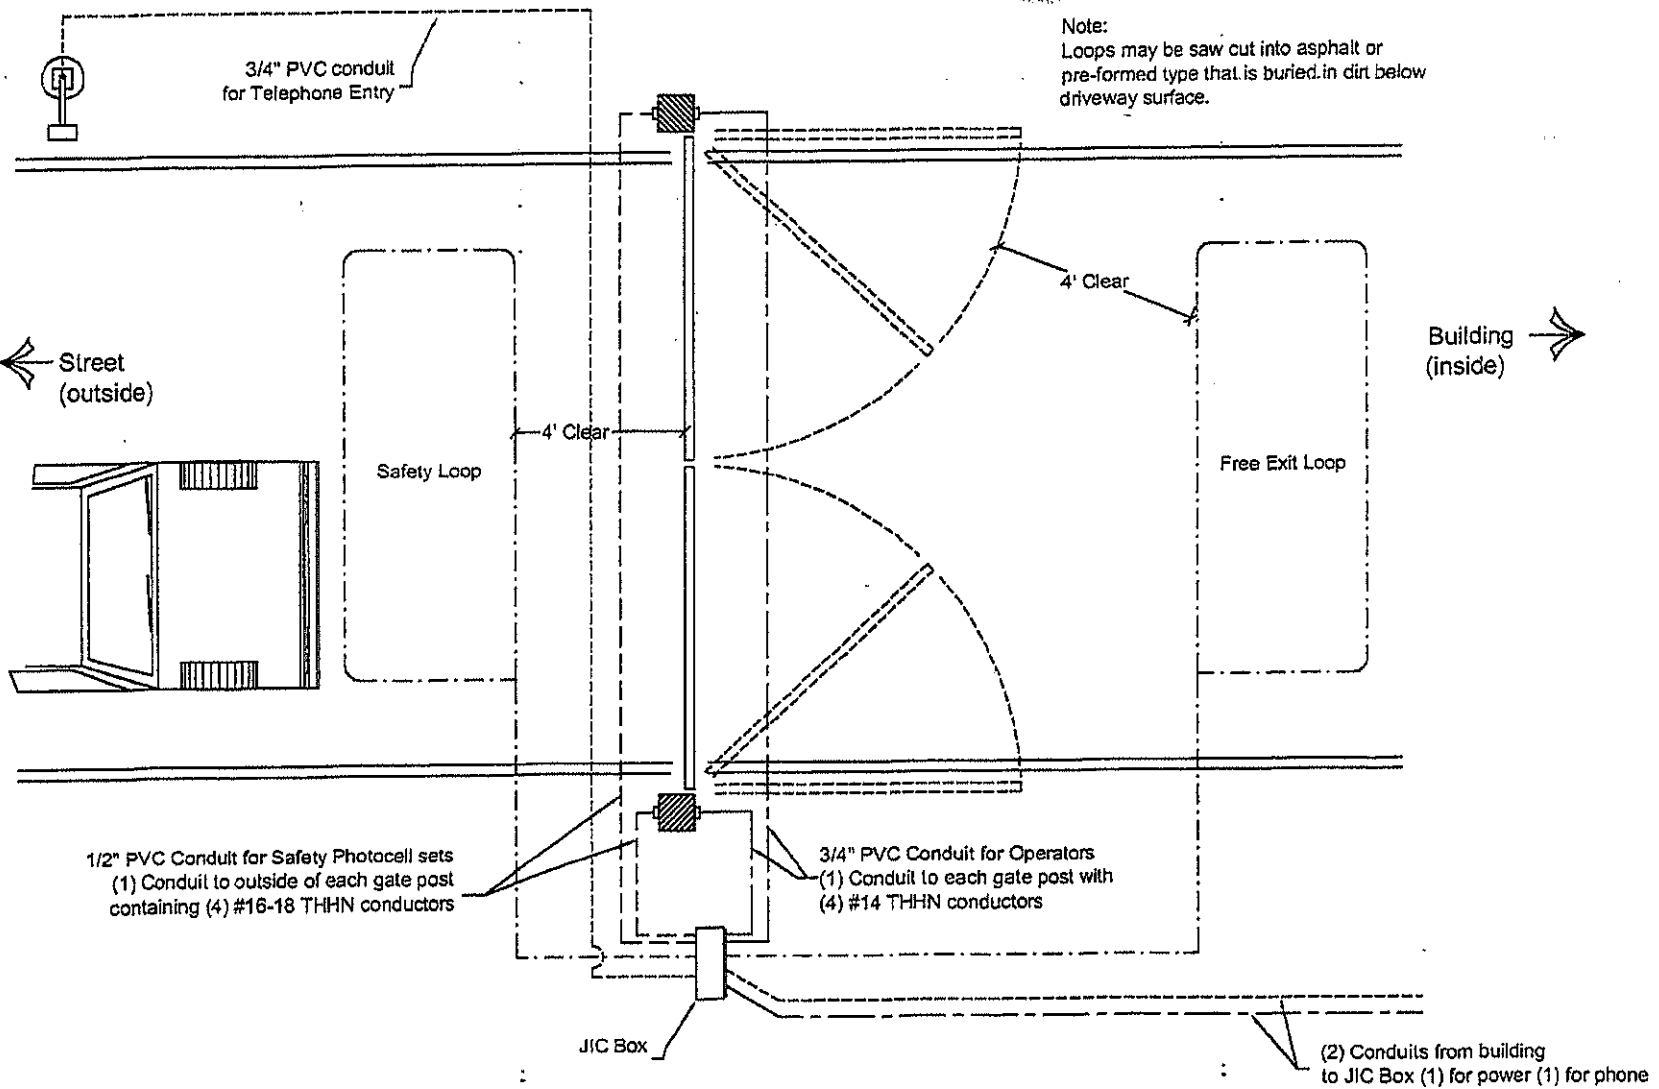

Open Sesame, Inc. Tel: 800-666-4798
 70 James Street, Worcester, MA 01603 Fax: 508-752-6824

Date Drawn: 1/18/03	Scale: Not to Scale	Customer: Layout #1 (reverse)
Drawn By: SDD	Project #: XXXXX	Page# _____ of _____